

IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems

Sponsor

Standards Coordinating Committee 21

(Fuel Cells, Photovoltaics, Dispersed Generation, and Energy Storage)

Approved 12 June 2003

IEEE-SA Standards Board

Abstract: This standard is the first in the 1547 series of interconnection standards and is a benchmark milestone demonstrating the open consensus process for standards development. Traditionally, utility electric power systems (EPS--grid or utility grid) were not designed to accommodate active generation and storage at the distribution level. As a result, there are major issues and obstacles to an orderly transition to using and integrating distributed power resources with the grid. The lack of uniform national interconnection standards and tests for interconnection operation and certification, as well as the lack of uniform national building, electrical, and safety codes, are understood. IEEE Std 1547 and its development demonstrate a model for ongoing success in establishing additional interconnection agreements, rules, and standards, on a national, regional, and state level. IEEE Std 1547 has the potential to be used in federal legislation and rule making and state public utilities commission (PUC) deliberations, and by over 3000 utilities in formulating technical requirements for interconnection agreements for distributed generators powering the electric grid.

This standard focuses on the technical specifications for, and testing of, the interconnection itself. It provides requirements relevant to the performance, operation, testing, safety considerations, and maintenance of the interconnection. It includes general requirements, response to abnormal conditions, power quality, islanding, and test specifications and requirements for design, production, installation evaluation, commissioning, and periodic tests. The stated requirements are universally needed for interconnection of distributed resources (DR), including synchronous machines, induction machines, or power inverters/converters and will be sufficient for most installations. The criteria and requirements are applicable to all DR technologies, with aggregate capacity of 10 MVA or less at the point of common coupling, interconnected to electric power systems at typical primary and/or secondary distribution voltages. Installation of DR on radial primary and secondary distribution systems is the main emphasis of this document, although installation of DR on primary and secondary network distribution systems is considered. This standard is written considering that the DR is a 60 Hz source.

Keywords: certification; codes; commissioning, dc injection; design, field, installation, production tests; communications; diesel generators; distributed generation, power; resources; electric distribution systems; dispersed generation, storage; energy storage; faults; flicker; fuel cells; generators; grid; harmonics; IEEE; induction machines; inverters; interconnection requirements and specifications; islanding; microturbines; monitoring and control; paralleling; power converters, networks, quality; photovoltaic power systems; point of common coupling; public utility commissions; reclosing coordination; regulations; rule making, federal, national, regional, state; standards; synchronous machines; testing; utilities; wind energy systems

The Institute of Electrical and Electronics Engineers, Inc.
3 Park Avenue, New York, NY 10016-5997, USA

Copyright © 2003 by the Institute of Electrical and Electronics Engineers, Inc.
All rights reserved. Published 28 July 2003. Printed in the United States of America.

IEEE is a registered trademark in the U.S. Patent & Trademark Office, owned by the Institute of Electrical and Electronics Engineers, Incorporated.

Print: ISBN 0-7381-3720-0 SH95144
PDF: ISBN 0-7381-3721-9 SS95144

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

IEEE Standards documents are developed within the IEEE Societies and the Standards Coordinating Committees of the IEEE Standards Association (IEEE-SA) Standards Board. The IEEE develops its standards through a consensus development process, approved by the American National Standards Institute, which brings together volunteers representing varied viewpoints and interests to achieve the final product. Volunteers are not necessarily members of the Institute and serve without compensation. While the IEEE administers the process and establishes rules to promote fairness in the consensus development process, the IEEE does not independently evaluate, test, or verify the accuracy of any of the information contained in its standards.

Use of an IEEE Standard is wholly voluntary. The IEEE disclaims liability for any personal injury, property or other damage, of any nature whatsoever, whether special, indirect, consequential, or compensatory, directly or indirectly resulting from the publication, use of, or reliance upon this, or any other IEEE Standard document.

The IEEE does not warrant or represent the accuracy or content of the material contained herein, and expressly disclaims any express or implied warranty, including any implied warranty of merchantability or fitness for a specific purpose, or that the use of the material contained herein is free from patent infringement. IEEE Standards documents are supplied "AS IS."

The existence of an IEEE Standard does not imply that there are no other ways to produce, test, measure, purchase, market, or provide other goods and services related to the scope of the IEEE Standard. Furthermore, the viewpoint expressed at the time a standard is approved and issued is subject to change brought about through developments in the state of the art and comments received from users of the standard. Every IEEE Standard is subjected to review at least every five years for revision or reaffirmation. When a document is more than five years old and has not been reaffirmed, it is reasonable to conclude that its contents, although still of some value, do not wholly reflect the present state of the art. Users are cautioned to check to determine that they have the latest edition of any IEEE Standard.

In publishing and making this document available, the IEEE is not suggesting or rendering professional or other services for, or on behalf of, any person or entity. Nor is the IEEE undertaking to perform any duty owed by any other person or entity to another. Any person utilizing this, and any other IEEE Standards document, should rely upon the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

Interpretations: Occasionally questions may arise regarding the meaning of portions of standards as they relate to specific applications. When the need for interpretations is brought to the attention of IEEE, the Institute will initiate action to prepare appropriate responses. Since IEEE Standards represent a consensus of concerned interests, it is important to ensure that any interpretation has also received the concurrence of a balance of interests. For this reason, IEEE and the members of its societies and Standards Coordinating Committees are not able to provide an instant response to interpretation requests except in those cases where the matter has previously received formal consideration.

Comments for revision of IEEE Standards are welcome from any interested party, regardless of membership affiliation with IEEE. Suggestions for changes in documents should be in the form of a proposed change of text, together with appropriate supporting comments. Comments on standards and requests for interpretations should be addressed to:

Secretary, IEEE-SA Standards Board
445 Hoes Lane
P.O. Box 1331
Piscataway, NJ 08855-1331
USA

Note: Attention is called to the possibility that implementation of this standard may require use of subject matter covered by patent rights. By publication of this standard, no position is taken with respect to the existence or validity of any patent rights in connection therewith. The IEEE shall not be responsible for identifying patents for which a license may be required by an IEEE standard or for conducting inquiries into the legal validity or scope of those patents that are brought to its attention.

Authorization to photocopy portions of any individual standard for internal or personal use is granted by the Institute of Electrical and Electronics Engineers, Inc., provided that the appropriate fee is paid to Copyright Clearance Center. To arrange for payment of licensing fee, please contact Copyright Clearance Center, Customer Service, 222 Rosewood Drive, Danvers, MA 01923 USA; +1 978 750 8400. Permission to photocopy portions of any individual standard for educational classroom use can also be obtained through the Copyright Clearance Center.

Introduction

(This introduction is not part of IEEE Std 1547-2003, IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems.)

IEEE Std 1547-2003 is the first of a series of standards being developed by Standards Coordinating Committee 21 on Fuel Cells, Photovoltaics, Dispersed Generation, and Energy Storage (SCC21) concerning distributed resources interconnection. The titles of the additional documents in that series follow.

- IEEE P1547.1™ Draft Standard For Conformance Test Procedures for Equipment Interconnecting Distributed Resources with Electric Power Systems
- IEEE P1547.2™ Draft Application Guide for IEEE Std 1547-2003, IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems
- IEEE P1547.3™ Draft Guide for Monitoring, Information Exchange, and Control of Distributed Resources Interconnected with Electric Power Systems

This first publication of IEEE Std 1547-2003 is an outgrowth of the changes in the environment for production and delivery of electricity and builds on prior IEEE recommended practices and guidelines developed by SCC21 [e.g., IEEE Std 929™-2000, IEEE Recommended Practice for Utility Interface of Photovoltaic (PV) Systems], and Standards Coordinating Committee 23 on Dispersed Storage and Generation (e.g., IEEE Std 1001™-1988, Guide for Interfacing Dispersed Storage and Generation Facilities with Electric Utility Systems).

Traditionally, utility electric power systems (EPS) were not designed to accommodate active generation and storage at the distribution level. The technologies and operational concepts to properly integrate distributed resources (DR) into the existing EPS continue to be further developed to fully realize benefits and to avoid negative impacts on system reliability and safety.

There is a critical need to have a single document of consensus standard technical requirements for DR interconnection rather than having to conform to numerous local practices and guidelines. This standard addresses that critical need by providing uniform criteria and requirements relevant to the performance, operation, testing, safety considerations, and maintenance of the interconnection.

The intent of this standard is to define the technical requirements in a manner that can be universally adopted. The universality relates not only to the technical aspects, but also to the adoption of this standard as being pertinent across a number of industries and institutions, e.g., hardware manufacturers, utilities, energy service companies, codes and standards organizations, regulators and legislators, and other interested entities.

This standard focuses on the technical specifications for, and testing of, the interconnection itself, and not on the types of the DR technologies. This standard aims to be technology neutral, although cognizant that the technical attributes of DR and the types of EPSs do have a bearing on the interconnection requirements. The addition of DR to an EPS will change the system and its response in some manner. Although this standard establishes criteria and requirements for interconnection, this standard is not a design handbook nor is it an application guideline. This standard provides the minimum functional technical requirements that are universally needed to help assure a technically sound interconnection. Any additional local requirements should not be implemented to the detriment of the functional technical requirements of this standard.

It is beyond the scope of this standard to address the methods used for performing EPS impact studies, mitigating limitations of the Area EPS, or for addressing the business or tariff issues associated with interconnection.

Participants

At the time this standard was completed, the Standards Coordinating Committee 21 on Fuel Cells, Photovoltaics, Dispersed Generation, and Energy Storage had the following membership:

Richard DeBlasio, Chair
Steve Chalmers, Vice Chair
Thomas S. Basso, Secretary

Jerry Anderson
Jay Chamberlin
James M. Daley
Douglas C. Dawson
N. Richard Friedman

William E. Feero
Frank Goodman
Kelvin Hecht
Barry Hornberger
Joseph L. Koepfinger
Benjamin Kroposki

Robert McConnell
John Stevens
John Wiles
John Wohlgemuth
Timothy P. Zgonena

At the time this standard was completed, the Distributed Resources and Electric Power Systems Interconnection Working Group (P1547 WG) of the Standard Coordinating Committee 21 (SCC21) on Fuel Cells, Photovoltaics, Dispersed Generation, and Energy Storage had the following membership who participated in the preparation of this standard:

Richard DeBlasio, Chair
Frank Goodman, Vice Chair **Joseph L. Koepfinger, Vice Chair**
Thomas S. Basso, Secretary

William J. Ackerman
Larry Adams
J. Reese Adomaitis
Pirous (Pete) Ahkami
Naeem Ahmad
Richard (Rick) Allison
Peter Amos
Roger A. Argeñal
Martin Baier
Philip A. Baker
John C. Balachandra
Philip Barker
David Barone
David Bassett
Alan Bax
Edward Beardsworth
Terry Becker
Robert W. Beckwith
Michael Behnke
Stephen Berger
Michael L. S. Bergey
Charles Berry
Vijay Bhavaraju
John Bilash
Stanley Blazewicz
Werner M. Blumer
Robert E. Boettner
Bogdan Borowy
Ward Bower
Gerry Boyd
Carl C. Brittain
Steven R. Brockschink
M. N. (Mac) Brodie

Bill Brooks
Jack Brouwer
Demy Bucaneg
Brian Bui
Mike Bui
David Burnett
Michael V. Byrnes
John J. Bzura
Raphael Caire
Fernando Calderon
Bob Cantwell
Scott Anthony Castelaz
Alfonso Centuori
Steve Chalmers
Jay Chamberlin
Rob A. Chandler
Liuchen Chang
Jamie Chapman
Joe Chau
Simon H. Cheng
Muhammad Choudhry
Kurt K. Christensen
Lloyd Cibulka
Geoffrey F. Clark
David A. Cohen
Alan Collinson
Reginald Comfort
David Conover
Larry E. Conrad
Stephen P. Conrad
William (Bill) J. Cook
Ken L. Cooley
Garth Corey

Dave M. Costyk
William T. Crossland
Bob Cunningham
Zaher Daboussi
Jeff Dagle
James M. Daley
Murray W. Davis
Douglas C. Dawson
Joseph Debs
Charles DeCorse
Michael de'Marsi
David W. Dewis
Peter Dick
Paul A. Dolloff
Kevin E. Donahoe
David N. Dorsey
Michael T. Doyle
Per Drewes
H. G. (Bert) Dreyer
Roch Ducey
Thomas Duffy
Roger C. Dugan
Kevin Duggan
Mary Duggan
John A. Duncan
James Dunlop
George A. Earle
Stephen (Steve) E. Early
Michael Edds
Lynnda Ell
James W. Ellars
Daniel C. Engel
Neil Engelman

Gary R. Engmann
 Thomas (Tom) W. Ernst
 Davis P. Erwin
 Mark Federle
 William E. Feero
 Barry Feldman
 Ralph Ferraro
 Bob Fick
 Tom Field
 Al Folkman
 Lou Fonte
 Harvey Forest
 Bryan R. Fox
 David Frank
 Christopher Freitas
 Paul J. Frey
 N. Richard (Dick) Friedman
 Lisa Gagnon
 Joseph (Joe) Galdo
 Susan Gardner
 Wayne Gardner
 Andris Garsils
 Bryan Gernet
 Patsy Geske
 Mark Gibson
 Rick Gilliam
 Thomas C. J. Gleason
 Manuel Gonzalez
 Daniel A. Goodrich
 Tom Gordon
 Charles Gougler
 Ed Grebel
 Tom Greely
 Jim (Herbert) Green
 George T. Gurlaskie
 J. H. Gurney
 Lance P. Haines
 Kenneth Hall
 Bruce Hamilton
 Kent M. Harmon
 Brent Harris
 Louis Harris
 Ronald D. Hartzel
 Kelvin Hecht
 Christy Herig
 Steve Hester
 Clark G. Hochgraf
 Earl W. Hodge
 John Hoffner
 Stephen Hogan
 Craig F. Holmes
 Donald L. Hornak
 Barry Hornberger
 Raymond M. Hudson
 Doug Hunchuk
 Michael J. Hyland
 Joe Iannucci
 Michael (Mike) R. Ibold
 Carl Imhoff
 Michael R. Ingram

Nicholas A. Ioannou
 Jim R. Iverson
 Robert W. Jackson
 Robert H. Jones
 Stephen R. Jones
 Hal Kamigaki
 William Kaszeta
 John R. Kennedy
 Scott A. Kenner
 Darrell Kent
 Greg Kern
 Thomas Key
 Carl Keyes
 Yuri Khersonsky
 Brendan Kirby
 Robb Klashner
 Kurt Klunder
 Brenon Knaggs
 Ljubomir A. Kojovic
 (Christopher) Todd Kollross
 Frank Kornbaum
 Burton Krakow
 Kenneth Krastins
 Jan F. Kreider
 Ben Kroposki
 Dale Krummen
 Steve Kuehl
 Richard (Rick) Langley
 Leonard E. Lansing
 Chris Larsen
 Bruce K. Larson
 Bob Laufenberg
 Schienbein Lawrence
 Eric Le Courtois
 Louis Lefevre
 James W. Lemke
 Kevin LeRow
 David Leslie
 Ted Lesster
 Jason Lin
 Richard W. Lincoln
 William E. Liss
 James Long
 Kevin P. Loving
 Don Lowenberg
 Carl C. Lower
 Andrew R. Macko
 Scott Malinowski
 Arshad Mansoor
 Sylvain Martel
 Anthony Mazy
 Jeff McElray
 Frank R. McElvain
 Tim McIntyre
 Mike McKeon
 Tron Melzl
 Michael (Mike) Michaud
 Alex Mikonowicz
 Tor-Eivind Moen
 Robert L. (Larry) Morgan

Allen G. Morinec
 Blake B. Morrison
 Jay Morrison
 David H. Munyan
 Terrence W. Mysak
 Gary Nakarado
 Chet Napikoski
 Arun Narang
 Jerry Neal
 Bradley D. (Brad) Nelson
 Kenneth E. Nicholson
 Gary L. Olson
 Ron Onate
 Fari Ordubadi
 Paul A. Orr
 Ernie Palomino
 David Park
 Alfred Pattmann
 Fang Zheng Peng
 Charles H. Perry
 Jeff Petter
 Philip A. Philippidis
 Michael Pincus
 Jeff G. Pope
 Edan Prabhu
 Stan Pukash
 Ronald Quick
 Ed Quiroz
 Kaushik Rajashekara
 John A. Raksany
 Gregory J. Ramon
 Jim Ranfone
 Jason N. Richards
 George Ritchie
 Raymond Roberge
 George Robinson
 Charles Rogers
 Matt Romanow
 Bob Rose
 Paul Russell
 Bob Saint
 Daniel P. Sammon
 Daniel Sandoval
 Juan S. Santos
 Mark Sardella
 William W. Saylor
 Vince Scaini
 Patrick (Pat) K. Scharff
 Joe E. Schatz
 Jason Schripsema
 Charles Schwartz
 Gary W. Scott
 Gary Seifert
 James Sember
 Edward C. Shaffer
 Michael T. Sheehan
 Kent Sheldon
 Richard Shiroma
 Larry Shockling

Georg A. Shultz
 Herbert J. Sinnock
 Andrew Skok
 David R. Smith
 Jeff Smith
 Allan D. St. Peter
 Wayne Stec
 William J. Steeley
 Ed Stein
 Jon D. Steinmetz
 Dehn A. Stevens
 John Stevens
 Robert Stewart
 William Stillinger
 Robert Stokes
 Todd M. Strothers
 John V. Stutsman
 Charles R. Sufana
 Chase Sun
 Len Swanson
 Craig Taborsky
 Sonal Talati
 Larry Tangel

Paula A. Taylor
 Dave Tewari
 Rao Thallam
 Tony Thorne
 Elisabeth (Betty) A. Tobin
 Sondra Todd
 Dennis Tollefson
 Jim Tomaseski
 Ed Torrero
 David L. Townley
 Glen Tubrett
 David Van Holde
 Mohammad Vaziri
 Jerry Ventre
 Harry Vollkommer
 Dan Walker
 Simon Wall
 Tim (Carl T.) Wall
 Reigh A. Walling
 Daniel (Dan) J. Ward
 Byron Washom
 James (Jim) Watts

Howard Wenger
 Randall (Randy) West
 Rick West
 Ron Westfall
 John S. Wheat
 Charles Whitaker
 Kent Whitfield
 Robert Wichert
 John Wiles
 Pat A. Wilkins
 Paul H. Williams
 Robert Wills
 Thomas Wind
 John Wohlgenuth
 Ronald Wolk
 Ronald Wong
 Murty V. V. S. Yalla
 Mike Yang
 Henry W. Zaininger
 Timothy P. Zgonena
 Richard Zhang
 Donald (Don) W. Zipse
 Luis Zubieta

The following working group members participated in finalizing the development of the standard with working group inputs, and in facilitating the development of those inputs throughout the standards development process:

William J. Ackerman
 Thomas S. Basso
 M. N. (Mac) Brodie
 Stephen P. Conrad
 James M. Daley
 Murray W. Davis
 Richard DeBlasio
 Paul A. Dolloff

Thomas Duffy
 Lynnda Ell
 Thomas (Tom) W. Ernst
 N. Richard (Dick) Friedman
 Frank Goodman
 Clark G. Hochgraf
 Joseph L. Koepfinger
 Robert L. (Larry) Morgan

Gary L. Olson
 Charles Rogers
 Gary Seifert
 Chase Sun
 Reigh A. Walling
 Charles Whitaker
 Robert Wichert
 Timothy P. Zgonena

The following members of the balloting committee voted on this standard. Balloters may have voted for approval, disapproval, or abstention.

William Ackerman
 Larry Adams
 John Adomaitis
 Martin Baier
 John Banting
 Philip P. Barker
 George Bartok
 David Bassett
 Thomas S. Basso
 Michael Behnke
 Kenneth Behrendt
 William J. Bergman
 Vijay Bhavaraju
 Kenneth Birt
 Steven Brockschink
 Malcolm Brodie
 Gustavo Brunello
 Michael Bui
 John Bzura
 Fernando Calderon

Mark Carpenter
 Robert Cary
 Carlos H. Castro
 Stephen Chalmers
 Jay Chamberlin
 Simon Cheng
 Frances M. Cleveland
 Joseph S. Collura
 Serge Comtois
 Larry Conrad
 Stephen Conrad
 William Cook
 Garth Corey
 David Costyk
 Zaher Daboussi
 Guru Dutt Dhingra
 Paul Drum
 James M. Daley
 Stephen Dare
 Murray Davis

Douglas Dawson
 Richard DeBlasio
 Joseph Debs
 Greg Dettmer
 Eugene Peter Dick
 W. B. Dietzman
 Paul Dolloff
 Kevin Donahoe
 David N. Dorsey
 Randall Dotson
 Michael Doyle
 Herbert (Bert) Dreyer
 Thomas Duffy
 George Earle
 Stephen Early
 Michael Edds
 Lynnda Ell
 Gary Engmann
 Thomas Ernst
 William Feero

Kenneth Fodero
 N. Richard Friedman
 Joseph Galdo
 Andris Garsils
 Manuel Gonzalez
 Frank Goodman
 Daniel Goodrich
 Tom Gordon
 Charles Gougler
 Ed Grebel
 Thomas Greely
 Jim Green
 Clayton Griffin
 Randall Groves
 George Gurlaskie
 James Gurney
 Lance Haines
 Kenneth Hall
 Ronald Hartzel
 Roger Hedding
 Steven Hensley
 Charles Henville
 Christy Herig
 Clark Hochgraf
 Stephen J. Hogan
 Jerry Hohn
 Donald Hornak
 Barry N. Hornberger
 James D. Huddleston, III
 Raymond Hudson
 Michael Hyland
 Robert W. Jackson
 Brian Johnson
 Robert H. Jones
 Rene Jonker
 Hardy King
 Hal Kamigaki
 Douglas Kay
 Ali Kazemi
 John Kennedy
 Thomas Key
 Yuri Khersonsky
 Brendan Kirby
 L. Brenon Knaggs
 Joseph L. Koepfinger
 Kenneth Krastins
 Edward Krizauskas
 Benjamin Kroposki
 John Kueck
 Gary Kuzkin
 Robert Landman
 Kevin LeRow
 Gerald Lee

Yeou-Song Lee
 Jim Lemke
 David Leslie
 Jason Lin
 Vahid Madani
 Faramarz Maghsoodlou
 T. Scott Malinowski
 Anthony Mazy
 Walter McCannon
 James McConnach
 John D. McDonald
 Michael McDonald
 Peter McNutt
 Nigel McQuin
 Christopher Melhorn
 Gary Michel
 Dean Miller
 Robert L. (Larry) Morgan
 Allen Morinec
 Pratap Mysore
 Raj Naidu
 George Nail
 Anthony Napikoski
 Arun Narang
 Bradley Nelson
 Charles Ngethe
 Carl Niemann
 Daniel Nordell
 Gary L. Olson
 T. W. Olsen
 Fari Ordubadi
 Subhash Patel
 Michael Pehosh
 Robert Pettigrew
 Ralph Philbrook, III
 Philip Philippidis
 Stan Pukash
 Brian Purvis
 Ronald Quick
 Robert Rallo
 Jim Ranfone
 Raymond Roberge
 George E. Robinson
 Charles Rogers
 James Ruggieri
 Thomas Ruhlmann
 Bob Ryan
 Kuldip Sandhu
 Robert Saint
 Daniel Sammon
 Daniel Sandoval
 Steven Sano
 Gary W. Scott

Gary Seifert
 Michael Sheehan
 Richard Shiroma
 Larry Shockling
 Hong-Ming Shuh
 Tarlochan Sidhu
 Mark Siira
 H. Jin Sim
 Herbert Sinnock
 Veselin Skendzic
 Andrew Skok
 Allan St. Peter
 Wayne Stec
 Jon Steinmetz
 Kevin Stephan
 Dehn Stevens
 John Stevens
 Charles Sufana
 Chase Sun
 Leonard G. Swanson
 Craig Taborsky
 Richard P. Taylor
 John Tengdin
 Malcolm Thaden
 Rao Thallam
 Elisabeth Tobin
 Sondra Todd
 Dennis Tollefson
 Eric Udren
 Gerald Vaughn
 Mohammad Vaziri Yazdi
 Jane Ann Verner
 Charles Wagner
 Joseph Waligorski
 Carl T. Wall
 Simon Wall
 Reigh Walling
 Daniel J. Ward
 John Wardlow
 Cheryl Warren
 James Watts
 Randall West
 Ronald Westfall
 Chuck Whitaker
 Robert Wichert
 Robert Wills
 James Wilson
 Thomas Wind
 Philip Winston
 Jonathan Woodworth
 Murty Yalla
 Timothy P. Zgonena
 Karl Zimmerman

When the IEEE-SA Standards Board approved this standard on 12 June 2003, it had the following membership:

Don Wright, *Chair*
Howard M. Frazier, *Vice Chair*
Judith Gorman, *Secretary*

H. Stephen Berger
Joe Bruder
Bob Davis
Richard DeBlasio
Julian Forster*
Toshio Fukuda
Arnold M. Greenspan
Raymond Hapeman

Donald M. Heirman
Laura Hitchcock
Richard H. Hulett
Anant Jain
Lowell G. Johnson
Joseph L. Koepfinger*
Tom McGean
Steve Mills

Daleep C. Mohla
William J. Moylan
Paul Nikolic
Gary Robinson
Malcolm V. Thaden
Geoffrey O. Thompson
Doug Topping
Howard L. Wolfman

*Member Emeritus

Also included are the following nonvoting IEEE-SA Standards Board liaisons:

Alan Cookson, *NIST Representative*
Satish K. Aggarwal, *NRC Representative*

Noelle D. Humenick
IEEE Standards Project Editor

Contents

1.	Overview	1
1.1	Scope.....	1
1.2	Purpose.....	1
1.3	Limitations	2
2.	References.....	2
3.	Definitions and acronyms	3
3.1	Definitions	3
3.2	Acronyms.....	5
4.	Interconnection technical specifications and requirements	5
4.1	General requirements	6
4.2	Response to Area EPS abnormal conditions.....	7
4.3	Power quality	9
4.4	Islanding.....	10
5.	Interconnection test specifications and requirements	10
5.1	Design test.....	10
5.2	Production tests.....	13
5.3	Interconnection installation evaluation	14
5.4	Commissioning tests.....	14
5.5	Periodic interconnection tests	15
	Annex A (informative) Bibliography	16

IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems

1. Overview

This standard provides interconnection technical specifications and requirements, and test specifications and requirements. Additionally, there is a bibliography included as Annex A that lists citations referred to in this standard for informative purposes, but that are not required to be used in conjunction with this standard.

1.1 Scope

This standard establishes criteria and requirements for interconnection of distributed resources (DR) with electric power systems (EPS).

1.2 Purpose

This standard provides a uniform standard for interconnection of distributed resources with electric power systems. It provides requirements relevant to the performance, operation, testing, safety considerations, and maintenance of the interconnection.

The requirements shall be met at the point of common coupling (PCC), although the devices used to meet these requirements can be located elsewhere. This standard applies to interconnection based on the aggregate rating of all the DR units that are within the Local EPS. The functions of the interconnection system hardware and software that affect the Area EPS are required to meet this standard regardless of their location on the EPS.

The stated specifications and requirements, both technical and testing, are universally needed for interconnection of DR, including synchronous machines, induction machines, or power inverters/converters, and will be sufficient for most installations.¹

¹ Additional technical requirements and/or tests may be necessary for some limited situations.

1.3 Limitations

The criteria and requirements in this document are applicable to all distributed resource technologies, with aggregate capacity of 10 MVA or less at the PCC, interconnected to EPSs at typical primary and/or secondary distribution voltages. Installation of DR on radial primary and secondary distribution systems is the main emphasis of this standard, although installation of DR on primary and secondary network distribution systems is considered. This standard is written considering that the DR is a 60 Hz source.

- This standard does not define the maximum DR capacity for a particular installation that may be interconnected to a single PCC or connected to a given feeder.
- This standard does not prescribe DR self-protection or all operating requirements for DR units.
- This standard does not address planning, designing, operating, or maintaining the Area EPS.
- This standard does not apply to automatic transfer schemes in which load is transferred between the DR and the EPS in a momentary make-before-break operation provided the duration of paralleling the sources is less than 100 ms, except as noted in 4.1.4.

2. References

The following standards shall be used in conjunction with this standard. When the stated version of the following standards is superseded by an approved revision, then that revision shall apply.

The applicability of the following standards is determined by the specific requirements stated in this standard, such as requiring certain sections.

ANSI C84.1-1995, Electric Power Systems and Equipment—Voltage Ratings (60 Hz).²

IEEE Std C37.90.1TM-2002, IEEE Standard Surge Withstand Capability (SWC) Tests for Relays and Relay Systems Associated with Electric Power Apparatus.^{3,4}

IEEE Std C37.90.2TM-1995, IEEE Standard Withstand Capability of Relay Systems to Radiated Electromagnetic Interference from Transceivers.

IEEE Std C62.41.2TM-2002, IEEE Recommended Practice on Characterization of Surges in Low Voltage (1000 V and less) AC Power Circuits.

IEEE Std C62.45TM-2002, IEEE Recommended Practice on Surge Testing for Equipment Connected to Low-Voltage (1000V and Less) AC Power Circuits.

NEMA MG 1-1998, Motors and Generators, Revision 2.⁵

²ANSI publications are available from the Sales Department, American National Standards Institute, 25 West 43rd Street, 4th Floor, New York, NY 10036, USA (<http://www.ansi.org/>).

³The IEEE standards or products referred to in Clause 2 are trademarks owned by the Institute of Electrical and Electronics Engineers, Incorporated.

⁴IEEE publications are available from the Institute of Electrical and Electronics Engineers, 445 Hoes Lane, P.O. Box 1331, Piscataway, NJ 08855-1331, USA (<http://standards.ieee.org/>).

⁵NEMA publications are available from Global Engineering Documents, 15 Inverness Way East, Englewood, Colorado 80112, USA (<http://global.ihs.com/>).

3. Definitions and acronyms

For purposes of this standard, the following terms and definitions apply. IEEE 100™, *The Authoritative Dictionary of IEEE Standards Terms*, Seventh Edition [B4],⁶ should be referenced for terms not defined in this clause.

3.1 Definitions

3.1.1 area electric power system operator (Area EPS Operator): The entity responsible for designing, building, operating, and maintaining the Area EPS.


3.1.2 cease to energize: Cessation of energy outflow capability.

3.1.3 design test: Test of one or more devices made to a certain design to show that the design meets certain specifications.

3.1.4 distributed generation (DG): Electric generation facilities connected to an Area EPS through a PCC; a subset of DR.

3.1.5 distributed resources (DR): Sources of electric power that are not directly connected to a bulk power transmission system. DR includes both generators and energy storage technologies.

NOTE—See Figure 1 and Figure 2.

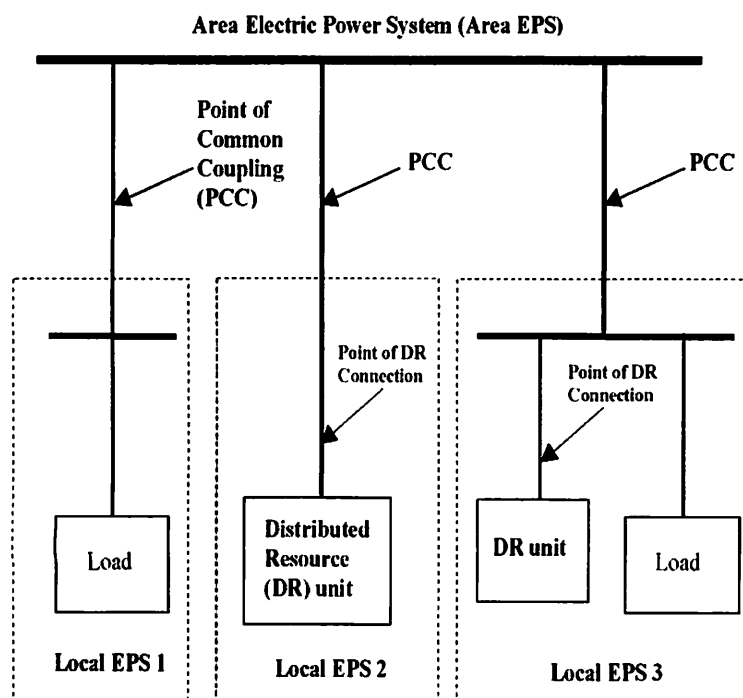

Note: Dashed lines are EPS boundaries. There can be any number of Local EPSs.

Figure 1—Relationship of interconnection terms

⁶The numbers in brackets correspond to those of the bibliography in Annex A.

3.1.6 electric power system (EPS): Facilities that deliver electric power to a load.

NOTE—This may include generation units. See Figure 1.

3.1.6.1 electric power system, area (Area EPS): An EPS that serves Local EPSs.

NOTE—Typically, an Area EPS has primary access to public rights-of-way, priority crossing of property boundaries, etc., and is subject to regulatory oversight. See Figure 1.

3.1.6.2 electric power system, local (Local EPS): An EPS contained entirely within a single premises or group of premises.

NOTE—See Figure 1.

3.1.7 interconnection: The result of the process of adding a DR unit to an Area EPS.

NOTE—See Figure 2.



Figure 2—Schematic of interconnection

3.1.8 interconnection equipment: Individual or multiple devices used in an interconnection system.

3.1.9 interconnection system: The collection of all interconnection equipment and functions, taken as a group, used to interconnect a DR unit(s) to an Area EPS.

NOTE—See Figure 2.

3.1.10 inverter: A machine, device, or system that changes direct-current power to alternating-current power.

3.1.11 island: A condition in which a portion of an Area EPS is energized solely by one or more Local EPSs through the associated PCCs while that portion of the Area EPS is electrically separated from the rest of the Area EPS.

3.1.11.1 island, intentional: A planned island.

3.1.11.2 island, unintentional: An unplanned island.

3.1.12 non-islanding: Intended to prevent the continued existence of an island.

3.1.13 point of common coupling (PCC): The point where a Local EPS is connected to an Area EPS.

NOTE—See Figure 1.

3.1.14 point of distributed resources connection (point of DR connection): The point where a DR unit is electrically connected in an EPS.

NOTE—See Figure 1.

3.1.15 simulated utility: An assembly of variable frequency and variable voltage test equipment used to simulate a normal utility source.

3.1.16 total demand distortion (TDD): The total root-sum-square harmonic current distortion, in percent of the maximum demand load current (15 or 30 minute demand).

3.1.17 total rated-current distortion (TRD): The total root-sum-square of the current harmonics created by the DR unit operating into a linear balanced load divided by the greater of the test load current demand (I_L) or the rated current capacity of the DR unit (I_{rated}).

3.2 Acronyms

Area EPS	Area electric power system
DG	distributed generation
DR	distributed resources
EPS	electric power system
I	current
I_L	load current
I_{SC}	short circuit current
Local EPS	Local electric power system
PCC	point of common coupling
TDD	total demand distortion
TRD	total rated-current distortion

4. Interconnection technical specifications and requirements

The requirements in this clause shall be met at the PCC, although the devices used to meet these requirements can be located elsewhere. The requirements apply to interconnection of either a single DR unit based on that unit's rating or multiple DR units within a single Local EPS, based on the aggregate rating of all the DR units that are within the Local EPS. The functions of the interconnection system hardware and software that affect the Area EPS are required to meet this standard regardless of their location on the EPS.

The requirements in this clause are functional and do not specify any particular equipment or equipment type.

The stated technical specifications and requirements are universally needed for interconnection of DR, including synchronous machines, induction machines, or static power inverters/converters, and will be sufficient for most installations.⁷

4.1 General requirements

4.1.1 Voltage regulation

The DR shall not actively regulate the voltage at the PCC. The DR shall not cause the Area EPS service voltage at other Local EPSs to go outside the requirements of ANSI C84.1-1995, Range A.

4.1.2 Integration with Area EPS grounding

The grounding scheme of the DR interconnection shall not cause overvoltages that exceed the rating of the equipment connected to the Area EPS and shall not disrupt the coordination of the ground fault protection on the Area EPS.

4.1.3 Synchronization

The DR unit shall parallel with the Area EPS without causing a voltage fluctuation at the PCC greater than $\pm 5\%$ of the prevailing voltage level of the Area EPS at the PCC, and meet the flicker requirements of 4.3.2.

4.1.4 Distributed resources on distribution secondary grid and spot networks

4.1.4.1 Distribution secondary grid networks

This topic is under consideration for future revisions of this standard.

4.1.4.2 Distribution secondary spot networks⁸

Network protectors shall not be used to separate, switch, serve as breaker failure backup or in any manner isolate a network or network primary feeder to which DR is connected from the remainder of the Area EPS, unless the protectors are rated and tested per applicable standards for such an application.⁹

Any DR installation connected to a spot network shall not cause operation or prevent reclosing of any network protectors installed on the spot network. This coordination shall be accomplished without requiring any changes to prevailing network protector clearing time practices of the Area EPS.

Connection of the DR to the Area EPS is only permitted if the Area EPS network bus is already energized by more than 50% of the installed network protectors.

The DR output shall not cause any cycling of network protectors.

The network equipment loading and fault interrupting capacity shall not be exceeded with the addition of DR.

⁷Additional technical requirements may be necessary for some limited situations.

⁸When required by the authority who has jurisdiction over the DR interconnection, a study may be conducted to determine that all of the requirements of this subclause can be met when the aggregate DR installed on a spot network exceeds 5% of the spot network's maximum load.

⁹IEEE C37.108™-2002 [B8] and IEEE C57.12.44™-2000 [B9] provide guidance on the capabilities of network systems to accept distributed resources.

DR installations on a spot network, using an automatic transfer scheme in which load is transferred between the DR and the EPS in a momentary make-before-break operation, shall meet all the requirements of this clause regardless of the duration of paralleling.

4.1.5 Inadvertent energization of the Area EPS

The DR shall not energize the Area EPS when the Area EPS is de-energized.

4.1.6 Monitoring provisions

Each DR unit of 250 kVA or more or DR aggregate of 250 kVA or more at a single PCC shall have provisions for monitoring its connection status, real power output, reactive power output, and voltage at the point of DR connection.

4.1.7 Isolation device

When required by the Area EPS operating practices, a readily accessible, lockable, visible-break isolation device shall be located between the Area EPS and the DR unit.

4.1.8 Interconnect integrity

4.1.8.1 Protection from electromagnetic interference

The interconnection system shall have the capability to withstand electromagnetic interference (EMI) environments in accordance with IEEE Std C37.90.2-1995. The influence of EMI shall not result in a change in state or misoperation of the interconnection system.

4.1.8.2 Surge withstand performance

The interconnection system shall have the capability to withstand voltage and current surges in accordance with the environments defined in IEEE Std C62.41.2-2002 or IEEE Std C37.90.1-2002 as applicable.

4.1.8.3 Paralleling device

The interconnection system paralleling-device shall be capable of withstanding 220% of the interconnection system rated voltage.

4.2 Response to Area EPS abnormal conditions¹⁰

Abnormal conditions can arise on the Area EPS that require a response from the connected DR. This response contributes to the safety of utility maintenance personnel and the general public, as well as the avoidance of damage to connected equipment, including the DR. All voltage and frequency parameters specified in these subclauses shall be met at the PCC, unless otherwise stated.

4.2.1 Area EPS faults

The DR unit shall cease to energize the Area EPS for faults on the Area EPS circuit to which it is connected.

¹⁰The isolation of a portion of the Area EPS, presenting the potential for an unintended DR island, is a special concern and is addressed in 4.4.1. Setting adjustments may only be made as approved by the authority who has jurisdiction over the DR interconnection.

4.2.2 Area EPS reclosing coordination

The DR shall cease to energize the Area EPS circuit to which it is connected prior to reclosure by the Area EPS.

4.2.3 Voltage

The protection functions of the interconnection system shall detect the effective (rms) or fundamental frequency value of each phase-to-phase voltage, except where the transformer connecting the Local EPS to the Area EPS is a grounded wye-wye configuration, or single-phase installation, the phase-to-neutral voltage shall be detected. When any voltage is in a range given in Table 1, the DR shall cease to energize the Area EPS within the clearing time as indicated. Clearing time is the time between the start of the abnormal condition and the DR ceasing to energize the Area EPS. For DR less than or equal to 30 kW in peak capacity, the voltage set points and clearing times shall be either fixed or field adjustable. For DR greater than 30 kW, the voltage set points shall be field adjustable.

The voltages shall be detected at either the PCC or the point of DR connection when any of the following conditions exist:

- a) The aggregate capacity of DR systems connected to a single PCC is less than or equal to 30 kW,
- b) The interconnection equipment is certified to pass a non-islanding test for the system to which it is to be connected,
- c) The aggregate DR capacity is less than 50% of the total Local EPS minimum annual integrated electrical demand for a 15 minute time period, and export of real or reactive power by the DR to the Area EPS is not permitted.

Table 1—Interconnection system response to abnormal voltages

Voltage range (% of base voltage ^a)	Clearing time(s) ^b
$V < 50$	0.16
$50 \leq V < 88$	2.00
$110 < V < 120$	1.00
$V \geq 120$	0.16

^aBase voltages are the nominal system voltages stated in ANSI C84.1-1995, Table 1.

^bDR $\leq$ 30 kW, maximum clearing times; DR > 30kW, default clearing times.

4.2.4 Frequency

When the system frequency is in a range given in Table 2, the DR shall cease to energize the Area EPS within the clearing time as indicated. Clearing time is the time between the start of the abnormal condition and the DR ceasing to energize the Area EPS. For DR less than or equal to 30 kW in peak capacity, the frequency set points and clearing times shall be either fixed or field adjustable. For DR greater than 30 kW, the frequency set points shall be field adjustable.

Adjustable under-frequency trip settings shall be coordinated with Area EPS operations.

Table 2—Interconnection system response to abnormal frequencies

DR size	Frequency range (Hz)	Clearing time(s) ^a
≤ 30 kW	> 60.5	0.16
	< 59.3	0.16
> 30 kW	> 60.5	0.16
	< {59.8 – 57.0} (adjustable set point)	Adjustable 0.16 to 300
	< 57.0	0.16

^aDR ≤ 30 kW, maximum clearing times; DR > 30 kW, default clearing times.

4.2.5 Loss of synchronism

Loss of synchronism protection is not required except as necessary to meet 4.3.2.

4.2.6 Reconnection to Area EPS

After an Area EPS disturbance, no DR reconnection shall take place until the Area EPS voltage is within Range B of ANSI C84.1-1995, Table 1, and frequency range of 59.3 Hz to 60.5 Hz.

The DR interconnection system shall include an adjustable delay (or a fixed delay of five minutes) that may delay reconnection for up to five minutes after the Area EPS steady-state voltage and frequency are restored to the ranges identified above.

4.3 Power quality

4.3.1 Limitation of dc injection

The DR and its interconnection system shall not inject dc current greater than 0.5% of the full rated output current at the point of DR connection.

4.3.2 Limitation of flicker induced by the DR

The DR shall not create objectionable flicker for other customers on the Area EPS.¹¹

4.3.3 Harmonics

When the DR is serving balanced linear loads, harmonic current injection into the Area EPS at the PCC shall not exceed the limits stated below in Table 3. The harmonic current injections shall be exclusive of any harmonic currents due to harmonic voltage distortion present in the Area EPS without the DR connected.

¹¹Flicker is considered objectionable when it either causes a modulation of the light level of lamps sufficient to be irritating to humans, or causes equipment misoperation. For guidance, refer to IEEE Std 519™-1992 [B5], IEEE P1453™ [B10], IEC/TR3 61000-3-7 [B1], IEC 61000-4-15 [B2], IEC 61400-21 [B3].

Table 3—Maximum harmonic current distortion in percent of current (I)^a

Individual harmonic order h (odd harmonics) ^b	$h < 11$	$11 \leq h < 17$	$17 \leq h < 23$	$23 \leq h < 35$	$35 \leq h$	Total demand distortion (TDD)
Percent (%)	4.0	2.0	1.5	0.6	0.3	5.0

^a I = the greater of the Local EPS maximum load current integrated demand (15 or 30 minutes) without the DR unit, or the DR unit rated current capacity (transformed to the PCC when a transformer exists between the DR unit and the PCC).

^b Even harmonics are limited to 25% of the odd harmonic limits above.

4.4 Islanding

4.4.1 Unintentional islanding

For an unintentional island in which the DR energizes a portion of the Area EPS through the PCC, the DR interconnection system shall detect the island and cease to energize the Area EPS within two seconds of the formation of an island.¹²

4.4.2 Intentional islanding

This topic is under consideration for future revisions of this standard.

5. Interconnection test specifications and requirements

This clause provides the test requirements to demonstrate that the interconnection system meets the requirements of Clause 4. The applicable tests from this clause are required for all interconnection systems. The results of these tests shall be formally documented.

The stated test specifications and requirements are universally needed for interconnection of DR including synchronous machines, induction machines, or static power inverters/converters, and will be sufficient for most installations.¹³

5.1 Design test

This design test shall be performed as applicable to the specific interconnection system technology. The test shall be performed on a representative sample, either in the factory, at a testing laboratory, or on equipment in the field.¹⁴

¹²Some examples by which this requirement may be met are:

1. The DR aggregate capacity is less than one-third of the minimum load of the Local EPS.
2. The DR is certified to pass an applicable non-islanding test.
3. The DR installation contains reverse or minimum power flow protection, sensed between the Point of DR Connection and the PCC, which will disconnect or isolate the DR if power flow from the Area EPS to the Local EPS reverses or falls below a set threshold.
4. The DR contains other non-islanding means, such as a) forced frequency or voltage shifting, b) transfer trip, or c) governor and excitation controls that maintain constant power and constant power factor.

¹³Additional tests may be necessary for some limited situations.

¹⁴The design test of 5.1 may be adopted as the testing basis for certification of interconnection systems.

This test applies to a packaged interconnection system using embedded components or to an interconnection system that uses an assembly of discrete components.

The design test shall be conducted on the same sample in the sequence of Table 4.

Table 4—Sequence for conducting design test

Required order	Design test clause and title
1	5.1.1 Response to abnormal voltage and frequency
2	5.1.2 Synchronization
3	5.1.3 Interconnect integrity test
Suggested order	
4	5.1.1 Response to abnormal voltage and frequency
5	5.1.2 Synchronization
6	5.1.4 Unintentional islanding
7	5.1.5 Limitation of dc injection
8	5.1.6 Harmonics

5.1.1 Response to abnormal voltage and frequency

This test shall demonstrate that the DR ceases to energize the Area EPS when the voltage or frequency exceeds the limits as specified in 4.2.3 and 4.2.4. Interconnection systems provided with field adjustable set points shall also be tested at the minimum, midpoint, and maximum of the adjustable set point ranges. These tests shall be conducted using either the simulated utility or secondary injection method.

5.1.2 Synchronization

Test results conforming to requirements of A, B, or C below are accepted as indicating compliance with the requirements of 4.1.3. The appropriate conditions to be met for specific interconnection system technology follow.

A. Synchronous interconnection to an EPS, or an energized local EPS to an energized Area EPS

This test shall demonstrate that at the moment of the paralleling-device closure, all three parameters in Table 5 are within the stated ranges. This test shall also demonstrate that if any of the parameters are outside of the ranges stated in the table, the paralleling-device shall not close.

B. Induction interconnection

Self-excited induction generators shall be tested as per A in 5.1.2.

This test shall determine the maximum start-up (in-rush) current drawn by the unit.¹⁵ The results shall be used, along with Area EPS impedance information for the proposed location, to estimate the starting voltage

¹⁵NEMA MG 1-1998 contains an acceptable method for determining inrush current.

Table 5—Synchronization parameter limits for synchronous interconnection to an EPS, or an energized local EPS to an energized Area EPS

Aggregate rating of DR units (kVA)	Frequency difference (Δf , Hz)	Voltage difference (ΔV , %)	Phase angle difference ($\Delta \Phi$, °)
0 – 500	0.3	10	20
> 500 – 1 500	0.2	5	15
> 1 500 – 10 000	0.1	3	10

drop and verify that the unit shall not exceed the synchronization requirements in 4.1.3 and the flicker requirements in 4.3.2.

C. Inverter interconnection¹⁶

An inverter-based interconnection system that produces fundamental voltage before the paralleling device is closed shall be tested according to the procedure for synchronous interconnection as stated in A of 5.1.2.

All other inverter-based interconnection systems shall be tested to determine the maximum start-up current. The results shall be used, along with Area EPS impedance for the proposed location, to estimate the starting voltage magnitude change and verify that the unit shall meet the synchronization requirements in 4.1.3 and the flicker requirements in 4.3.2.

5.1.3 Interconnect integrity test

5.1.3.1 Protection from EMI

The interconnection system shall be tested in accordance with IEEE Std C37.90.2-1995 to confirm that the results are in compliance with 4.1.8.1. The influence of EMI shall not result in a change in state or mis-operation of the interconnection system.

5.1.3.2 Surge withstand performance

The interconnection system shall be tested for the requirement in 4.1.8.2 in all normal operating modes in accordance with IEEE Std C62.45-2002 for equipment rated less than 1000 V to confirm that the surge withstand capability is met by using the selected test level(s) from IEEE Std C62.41.2-2002. Interconnection system equipment rated greater than 1000 V shall be tested in accordance with manufacturer or system integrator designated applicable standards. For interconnection system equipment signal and control circuits, use IEEE Std C37.90.1-2002. The results of these tests shall indicate the unit did not fail, did not mis-operate, and did not provide misinformation.

5.1.3.3 Paralleling device

A dielectric test across the open-circuited paralleling device shall be conducted to confirm compliance with the requirements of 4.1.8.3.

5.1.4 Unintentional Islanding

A test or field verification shall be conducted to confirm that 4.4.1 is met regardless of the selected method of detecting isolation.¹⁷

¹⁶Some inverter-based interconnection systems may need to be tested to both requirements of C in 5.1.2.

5.1.5 Limitation of dc injection

Inverter based DR shall be tested to confirm that the DR does not inject dc current greater than prescribed limits that are listed in 4.3.1.

5.1.6 Harmonics

The intent of the harmonics interconnection test is to assess that under a controlled set of conditions the DR unit meets the harmonic limits specified in 4.3.3.

The DR shall be operated in parallel with a predominantly inductive voltage source with a short circuit current capacity I_{SC} of not less than 20 times the DR rated output current at fundamental frequency. The voltage and frequency output of the voltage source shall correspond to the rated voltage and frequency of the DR. The unloaded voltage waveform produced by the Area EPS or simulated utility voltage source shall have a total harmonic distortion (THD) less than 2.5%.

The DR shall be operated at an output test load current, I_L , of 33%, 66%, and at a level as close to 100% of rated output current as practical. Use total rated-current distortion (TRD) in place of TDD. TRD is the total rms value of the sum of the current harmonics created by the DR unit operating into a linear balanced load divided by the greater of the test load current (I_L) demand or the rated current capacity of the DR unit (I_{rated}). The individual harmonic distortion and TRD of the DR output current shall be measured for the first 40 harmonics. The harmonic current injections shall be exclusive of any harmonic currents due to harmonic voltage distortion present in the Area EPS without the DR connected. The test results shall not exceed the values in 4.3.3, Table 3.¹⁸

As an alternative, a synchronous generator DR shall be tested to meet the requirements of 4.3.3; either after installation or while powering a balanced resistive load and isolated from any other sources. The voltage harmonics while powering a resistive load at 100% of the machine kVA rating shall not exceed the levels in Table 6. Voltage harmonics shall be measured line to line for 3-phase/3 wire systems, and line to neutral for 3-phase/4-wire systems.

Table 6—Maximum harmonic voltage distortion in percent of rated voltage for synchronous machines

Individual harmonic order	$h < 11$	$11 \leq h < 17$	$17 \leq h < 23$	$23 \leq h < 35$	$35 \leq h$	Total harmonic distortion
Percent (%)	4.0	2.0	1.5	0.6	0.3	5.0

5.2 Production tests

Each interconnection system shall be subjected to requirements of 5.1.1 and 5.1.2. Interconnection systems with adjustable set points shall be tested at a single set of set points as specified by the manufacturer. This test may be conducted as a factory test or may be performed as part of a commissioning test (see 5.4).

¹⁷An example test is in UL 1741 [B14].

¹⁸These values or lower values may be required to meet the TDD of 5% at the PCC.

5.3 Interconnection installation evaluation

5.3.1 Grounding integration with Area EPS

A system design verification shall be made to ensure that the requirements of 4.1.2 have been met.

5.3.2 Isolation device

A system design verification shall be made to ensure that the requirements of 4.1.7 have been met.

5.3.3 Monitoring provisions

A system design verification shall be made to ensure that the provisions for monitoring are in accordance with 4.1.6.

5.3.4 Area EPS faults

A system design verification shall be made to ensure that the requirements of 4.2.1 have been met.

5.3.5 Area EPS reclosing coordination

A system design verification shall be made to verify the interconnection system is coordinated with the Area EPS reclosing practices in accordance with 4.2.2.

5.4 Commissioning tests

All commissioning tests shall be performed based on written test procedures.¹⁹ The following visual inspections shall be performed.

- A visual inspection shall be made to ensure that the grounding coordination requirement of 4.1.2 has been implemented.
- A visual inspection shall be made to confirm the presence of the isolation device if required by 4.1.7.

Initial commissioning tests shall be performed on the installed DR and interconnection system equipment prior to the initial parallel operation of the DR. The following tests are required:

- Operability test on the isolation device
- Unintentional-islanding functionality as specified in 5.4.1
- Cease to energize functionality as specified in 5.4.2
- Any tests of 5.1 that have not been previously performed on a representative sample and formally documented
- Any tests of 5.2 that have not been previously performed

The applicable tests of 5.1 shall be repeated when:

- Functional software or firmware changes have been made on the interconnection system
- Any hardware component of the interconnection system has been modified in the field, or, replaced or repaired with parts different from the tested configuration.

Subclauses 5.4.1 and 5.4.2, and the applicable tests of 5.2 shall be repeated if:

¹⁹Test procedures are commonly provided by equipment manufacturer(s) or system integrator(s) and approved by the equipment owner and Area EPS operator.

- Protection settings have been changed after factory testing.
- Protection functions have been adjusted after the initial commissioning process.

5.4.1 Unintentional islanding functionality test

5.4.1.1 Reverse-power or minimum power test

A reverse-power or minimum power function, if used to meet the requirements of 4.4.1, shall be tested using injection techniques or by adjusting the DR output and local loads to verify that the reverse power or minimum power function is met.

5.4.1.2 Non-islanding functionality test

For non-islanding interconnection systems, 5.4.2 satisfies this requirement.

5.4.1.3 Other unintentional islanding functionality tests

If tests in 5.4.1.1 and 5.4.1.2 are not applicable to the interconnection system, the interconnection system shall be tested in accordance with procedures provided by the manufacturer or system integrator.

5.4.2 Cease to energize functionality test

Check the cease to energize functionality by operating a load interrupting device and verify the equipment ceases to energize its output terminals and does not restart/reconnect for the required time delay. The test shall be performed on each phase individually. This test verifies conformance to the cease to energize requirement of 4.1.4, 4.2.1, 4.2.2, 4.2.3, 4.2.4, and 4.4.1.

5.5 Periodic interconnection tests

All interconnection-related protective functions and associated batteries shall be periodically tested at intervals specified by the manufacturer, system integrator, or the authority who has jurisdiction over the DR interconnection. Periodic test reports or a log for inspection shall be maintained.

Annex A

(informative)

Bibliography

The following citations are referred to in this standard for informative purposes and are not required to be used in conjunction with this standard.

[B1] IEC TR3 61000-3-7, Assessment of Emission Limits for Fluctuating Loads in MV and HV Power Systems.

[B2] IEC 61000-4-15, Flickermeter—Functional and Design Specifications.

[B3] IEC 61400-21, Wind Turbine Generator Systems—Part 21: Measurement and Assessment of Power Quality Characteristics of Grid Connected Wind Turbines—Ed. 1.0 (2001-12).

[B4] IEEE 100, *The Authoritative Dictionary of IEEE Standards Terms*, Seventh Edition, New York, Institute of Electrical and Electronics Engineers, Inc.

[B5] IEEE Std 519-1992, IEEE Recommended Practices and Requirements for Harmonic Control in Electrical Power Systems.²⁰

[B6] IEEE Std 929TM-2000, IEEE Recommended Practice for Utility Interface of Photovoltaic (PV) Systems.

[B7] IEEE Std 1001TM-1988, IEEE Guide for Interfacing Dispersed Storage and Generation Facilities with Electric Utility Systems.

[B8] IEEE Std C37.108-1989 (R2002), IEEE Guide for the Protection of Network Transformers.

[B9] IEEE Std C57.12.44-2000, IEEE Standard Requirements for Secondary Network Protectors.

[B10] IEEE P1453, Draft Recommended Practice for Measurement and Limits of Voltage Flicker on AC Power Systems.

[B11] IEEE P1547.1TM, Draft Standard For Conformance Test Procedures for Equipment Interconnecting Distributed Resources with Electric Power Systems.

[B12] IEEE P1547.2TM, Draft Application Guide for IEEE Std 1547-2003, IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems.

[B13] IEEE P1547.3TM, Draft Guide for Monitoring, Information Exchange, and Control of Distributed Resources Interconnected with Electric Power Systems.

[B14] UL 1741, Inverters, Converters, and Controllers for Use in Independent Power Systems.

²⁰The IEEE standards or products referred to in Annex A are trademarks owned by the Institute of Electrical and Electronics Engineers, Incorporated.